


JUNCTION BOX DETAILS

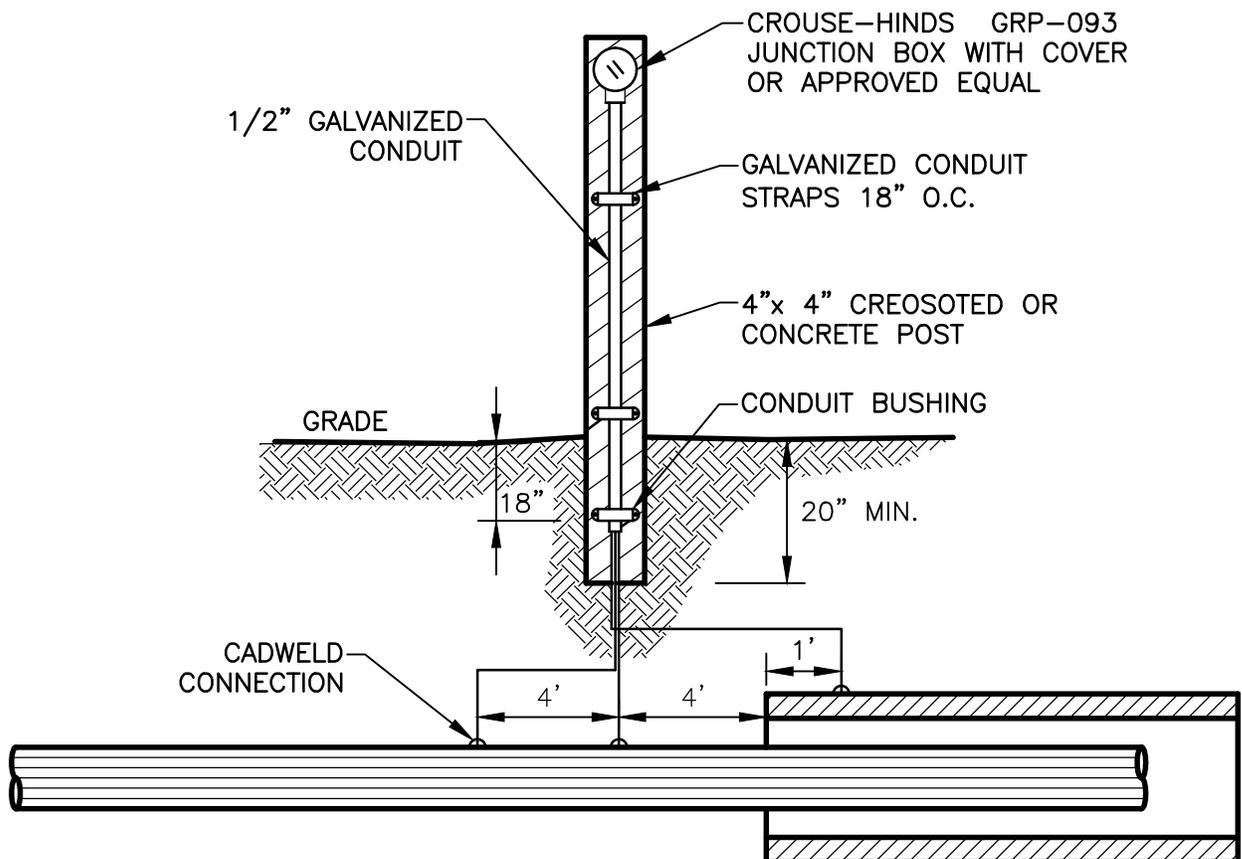

NOTES:

1. ALL WIRES TO BE #12 A.W.G. COPPER SINGLE CONDUCTOR, TW INSULATED LEAD WIRES TO BE COLOR CODED.
2. IF POSSIBLE, DELETE 4"x4" POST AND INSTALL TEST BOX AGAINST PERMANENT STRUCTURE.
3. MODIFICATION MAY BE MADE TO SUIT FIELD CONDITIONS.
4. CARE TO BE TAKEN DURING BACKFILLING TO PREVENT DAMAGE TO C.P. WIRES.

THIS DETAIL WAS TAKEN FROM THE CITY OF ATLANTA'S WEBSITE. IT MAY HAVE BEEN MODIFIED AND SHOULD BE REVIEWED THOROUGHLY.

City of Atlanta



STANDARD DETAILS

TYPICAL PIPE-CASING
CORROSION PROTECTION
TEST LEADS

REV.
DATE: OCT. 2011
ORIG. DATE: OCT. 2004
SCALE: N.T.S.

DETAIL NO. WR-G_CP001